



CITY OF HAWAIIAN GARDENS
 DEPARTMENT OF COMMUNITY DEVELOPMENT
 BUILDING AND SAFETY DIVISION
 21815 Pioneer Boulevard
 Hawaiian Gardens, Ca 90716
 (562) 420 2641

A-010

EFFECTIVE :
 1-05-2015

RESTROOM SIGNAGE – DOOR SIGNS



11B-703.2.1 Depth. Raised characters shall be 1/32 inch minimum about their background.

11B-703.2.2 Case. Characters shall be uppercase.

11B-703.2.3 Style. Characters shall be sans serif. Characters shall not be italic, oblique, scripts, highly decorative, or other unusual forms.

11B-703.2.4 Character proportions. Characters shall be selected from fonts where the width of the uppercase letter “O” is 60 percent minimum and 110 percent maximum of the height of the uppercase letter “I”.

11B-703.2.5 Character height. Character height measured vertically from the baseline of the character shall be 5/8 inch minimum and 2 inches maximum based on the height of the uppercase letter “I”.

11B-703.3 Braille. Braille shall be contracted (Grade 2) and shall comply with 703.3 and 703.4.

11B-703.3.1 Dimensions and capitalization. Braille dots shall have a domed or rounded shape and shall comply with Table 703.3.1. The indication of an uppercase letter or letters shall only be used before the first word of sentences, proper nouns and names, individual letters of the alphabet, initials, and acronyms.

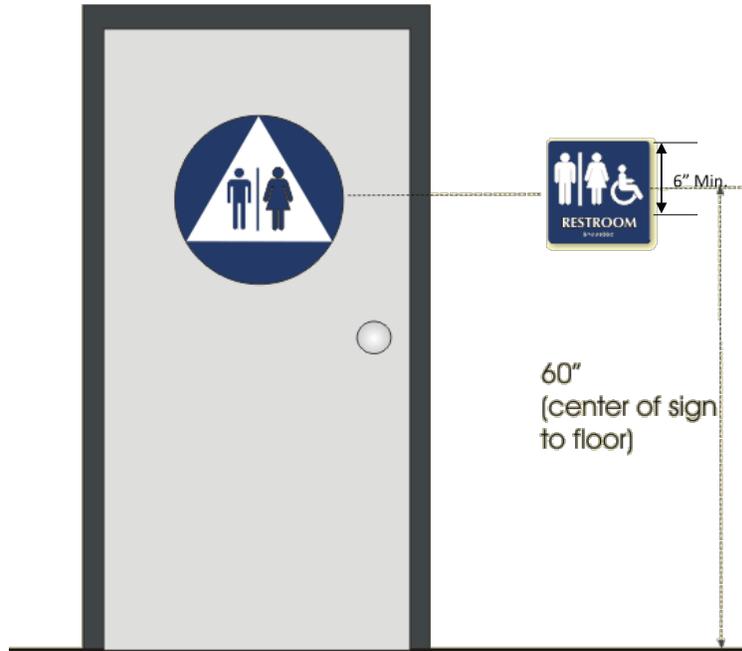


Table 11B-703.3.1 Braille Dimensions	
Measurement Range	Minimum in Inches Maximum in Inches
Dot base diameter	0.059 (1.5 mm) to 0.063 (1.6 mm)
Distance between two dots in the same cell ¹	0.090 (2.3 mm) to 0.100 (2.5 mm)
Distance between corresponding dots in adjacent cells ¹	0.241 (6.1 mm) to 0.300 (7.6 mm)
Dot height	0.025 (0.6 mm) to 0.037 (0.9 mm)
Distance between corresponding dots from one cell directly below ¹	0.395 (10 mm) to 0.400 (10.2 mm)
1. Measured center to center.	



11B-703.3.2 Position. Braille shall be positioned below the corresponding text. If text is multi-lined, braille shall be placed below the entire text. Braille shall be separated 3/8 inch (9.5 mm) minimum from any other tactile characters and 3/8 inch (9.5 mm) minimum from raised borders and decorative elements.

11B-703.5.1 Finish and Contrast. Characters and their background shall have a non-glare finish. Characters shall contrast with their background with either light characters on a dark background or dark characters on a light background.



11B-703.6.1 Pictogram Field. Pictograms shall have a field height of 6 inches (150 mm) minimum. Characters and braille shall not be located in the pictogram field.

11B-703.7.2.6 Toilet and bathing facilities geometric symbols. Doorways leading to toilet and bathing rooms shall be identified by a geometric symbol complying with Section 11B-703.7.2.6. The Symbol shall be mounted at 58 inches minimum and 60 inches maximum above the finish floor or ground surface measure from the centerline of the symbol. Where a door is provided the symbol shall be mounted within 1 inch of the vertical centerline of the door.



11B-703.7.2.6.3 Unisex toilet and bathing facilities. Unisex toilet and bathing facilities shall be identified by a circle, ¼ inch thick and 12 inches in diameter with a ¼ inch thick triangle with a vertex pointing upward superimposed on the circle and within the 12-inch diameter. The triangle symbol shall contrast with the circle symbol, either light on a dark background or dark on a light background. The circle symbol shall contrast with the door, either light on a dark background or dark on a light background.

11B-703.7.2.6.1 Men's toilet and bathing facilities. Men's toilet and bathing facilities shall be identified by an equilateral triangle, ¼ inch thick with edges 12 inches long and a vertex pointing upward. The triangle symbol shall contrast with the door, either light on a dark background or dark on a light background.

11B-703.7.2.6.2 Women's toilet and bathing facilities. Women's toilet and bathing facilities shall be identified by a circle, ¼ inch thick and 12 inches in diameter. The circle symbol shall contrast with the door, either light on a dark background or dark on a light background.